
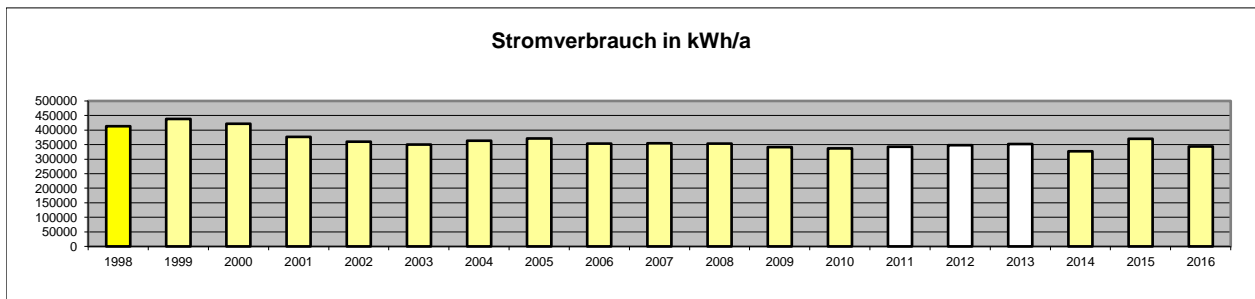


# Gustav-Heinemann-Gesamtschule

## Energieverbrauch (Heizung und Strom)

Vergleichsjahr 1998

Jahr	Wärme gemessen	Wärme bereinigt	Differenz kWh/a	Differenz Prozent	Strom kWh/a	Differenz kWh/a	Differenz Prozent
1998	1579201	1717295	0	0	413119	0	0
1999	1369732	1531794	-185501	-10,8%	437807	24688	6,0%
2000	1311098	1649606	-67689	-3,9%	421405	8286	2,0%
2001	1404573	1600572	-116723	-6,8%	376981	-36138	-8,7%
2002	1304957	1504793	-212502	-12,4%	359840	-53279	-12,9%
2003	1320514	1434946	-282349	-16,4%	349748	-63371	-15,3%
2004	1285755	1345933	-371362	-21,6%	363450	-49669	-12,0%
2005	1321267	1434204	-283091	-16,5%	371546	-41573	-10,1%
2006	1219022	1391245	-326050	-19,0%	352996	-60123	-14,6%
2007	1101062	1300702	-416593	-24,3%	354937	-58182	-14,1%
2008	1271952	1350829	-366466	-21,3%	353406	-59713	-14,5%
2009	1160492	1235083	-482212	-28,1%	341711	-71408	-17,3%
2010	1358263	1220239	-497056	-28,9%	337380	-75739	-18,3%
2011	1156922	1362930	-354365	-20,6%	342563	-70556	-17,1%
2012	1359850	1421511	-295784	-17,2%	347951	-65168	-15,8%
2013	1432073	1402131	-315164	-18,4%	351934	-61185	-14,8%
2014	1027060	1292776	-424519	-24,7%	327028	-86091	-20,8%
2015	1165231	1304986	-412309	-24,0%	369882	-43237	-10,5%
2016	1186056	1289771	-427524	-24,9%	343321	-69798	-16,9%

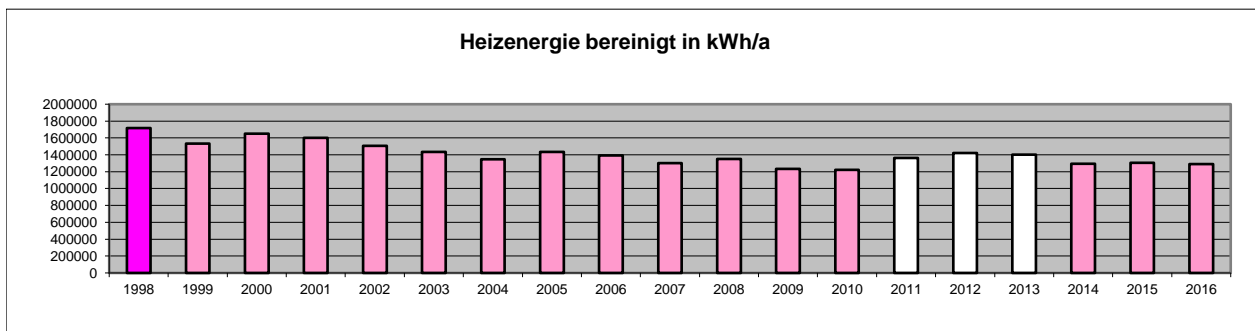

Von November 2011 bis Mai 2013 erhöhter Verbrauch von Strom und Heizenergie durch umfangreiche Sanierungsarbeiten (Containerdorf). Ab 2013 erhöhter Stromverbrauch durch zwei neue 3-kW-Server.

8/2017 B. Schoeps

